



CHANGE	
DATE: 2008-12-16	DRN: J.S.
SCALE: NTS	APPV'D:
DISK:	FILE:
PROJECT: System Configurations (fp+)	
DRAWING: 3 T21 (Soca)	
Plot: 1/2 (System)	Issue: 1

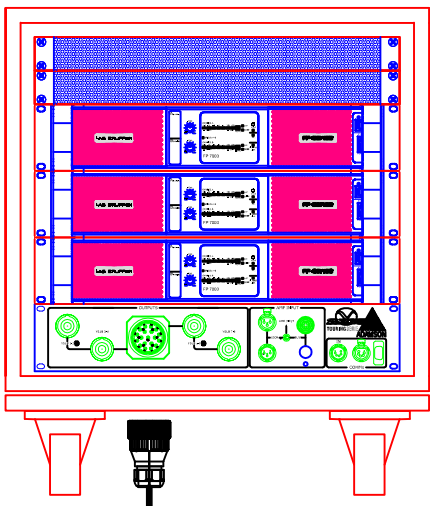

ADAMSON SYSTEMS ENGINEERING
1401 Scugog Line 6
Port Perry, ONTARIO, L9L 1B2
TEL:(905)982-0520 FAX:(905)982-0609

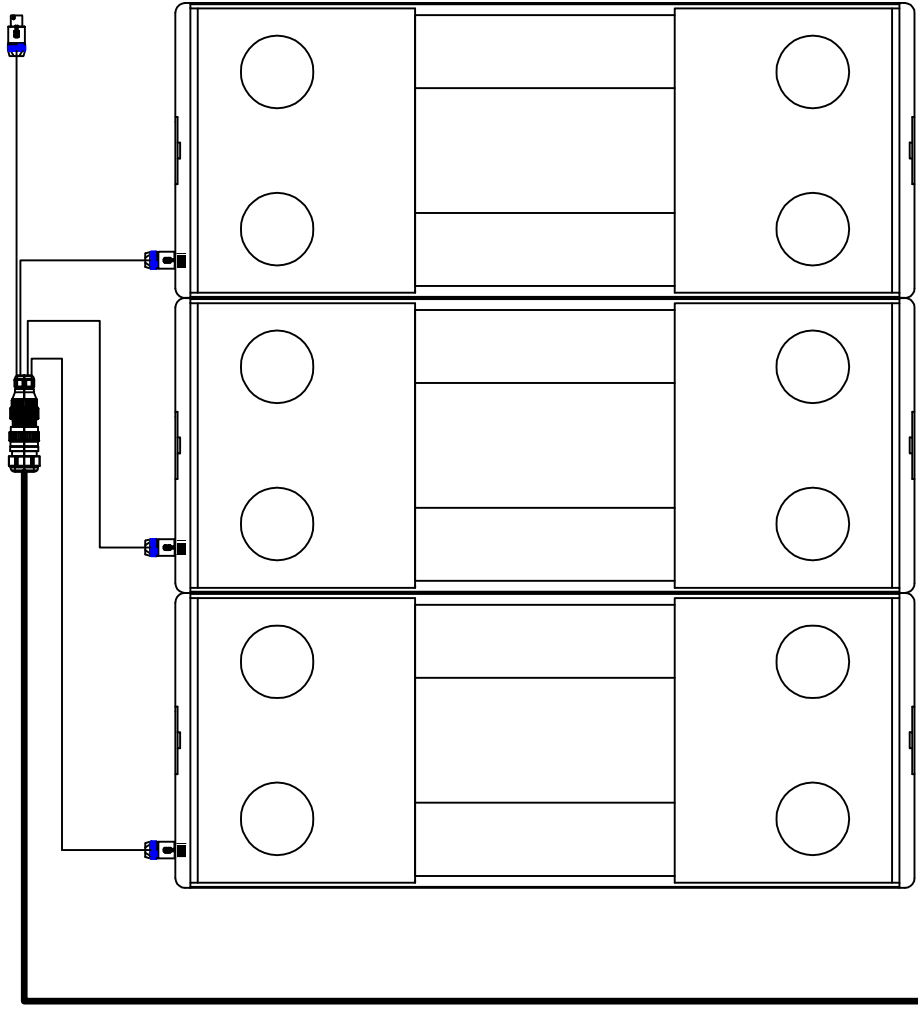

XTA DP424	Out 4 Sub	Note: The XTA Processor is typically located in a Y18/Y10 amplifier rack.
(magenta) FP 7000	Amp 1	CH A / CH B
Gain=29dB VPL 196V		
(magenta) FP 7000	Amp 2	CH A / CH B
Gain=29dB VPL 196V		
(magenta) FP 7000	Amp 3	CH A / CH B
Gain=29dB VPL 196V		

CHANGE	
DATE: 2008-12-16	DRN: J.S.
SCALE: NTS	APPV'D:
DISK:	FILE:
PROJECT: System Configurations (fp+)	
DRAWING: 3 T21 (Soca)	
Plot: 2/2 (Amp Rack)	Issue: 1

