



CHANGE	
DATE: 2008-12-16	DRN: J.S.
SCALE: NTS	APPV'D:
DISK:	FILE:
PROJECT: System Configurations (fp+)	
DRAWING: 4 T21 (Soca)	
Plot: 1/2 (System)	Issue: 1

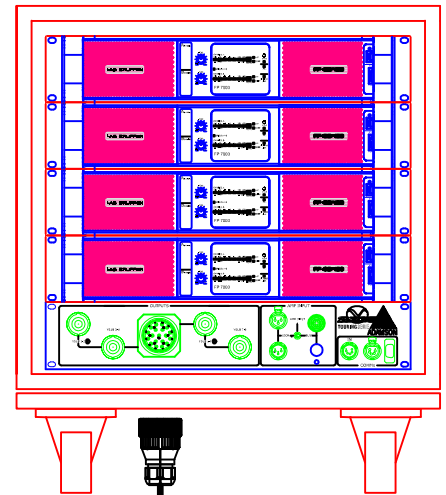

ADAMSON SYSTEMS ENGINEERING  
1401 Scugog Line 6  
Port Perry, ONTARIO, L9L 1B2  
TEL:(905)982-0520 FAX:(905)982-0609

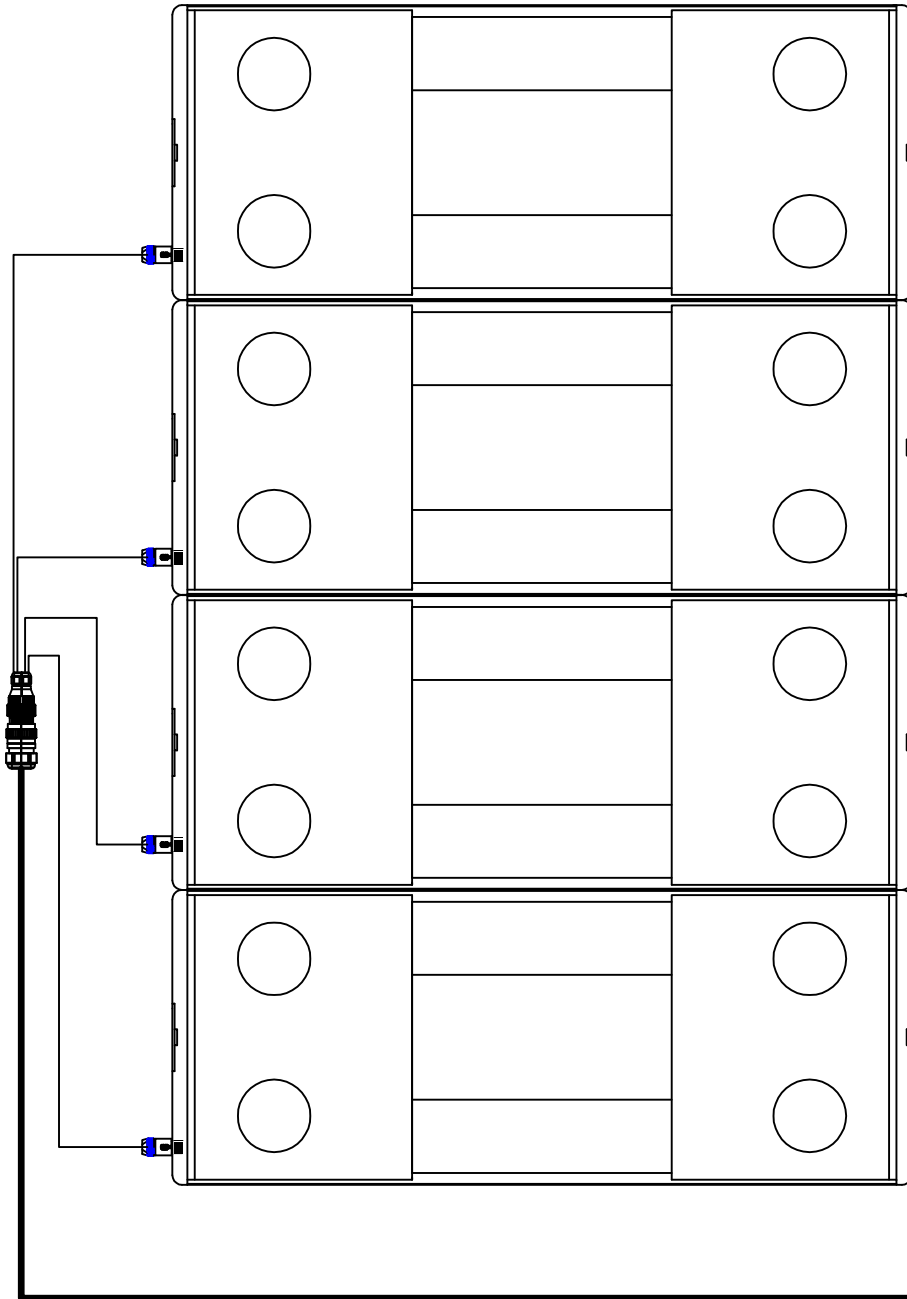

XTA DP424	Out 4 Sub	Note: The XTA Processor is typically located in a Y18/Y10 amplifier rack.
(magenta) FP 7000		
<b>Amp 1</b>	<b>CH A / CH B</b>	
Gain=29dB VPL 196V		
(magenta) FP 7000		
<b>Amp 2</b>	<b>CH A / CH B</b>	
Gain=29dB VPL 196V		
(magenta) FP 7000		
<b>Amp 3</b>	<b>CH A / CH B</b>	
Gain=29dB VPL 196V		
(magenta) FP 7000		
<b>Amp 4</b>	<b>CH A / CH B</b>	
Gain=29dB VPL 196V		

CHANGE	
DATE: 2008-12-16	DRN: J.S.
SCALE: NTS	APPV'D:
DISK:	FILE:
PROJECT: System Configurations (fp+)	
DRAWING: 4 T21 (Soca)	
Plot: 2/2 (Amp Rack)	Issue: 1

