



CHANGE	
DATE: 2008-12-15	DRN: J.S.
SCALE: NTS	APPV'D:
DISK:	FILE:
PROJECT: System Configurations (fp)	
DRAWING: 4 T21 (Soca)	
Plot: 1/2 (System)	Issue: 1

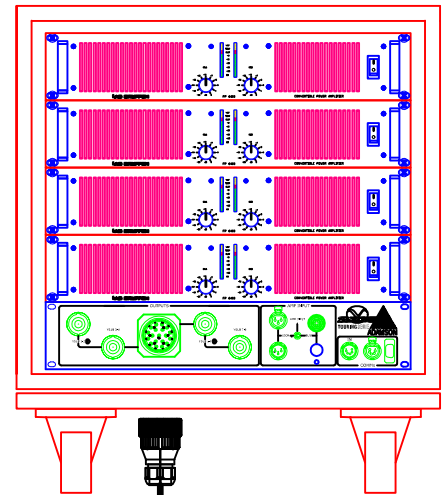

ADAMSON SYSTEMS ENGINEERING
1401 Scugog Line 6
Port Perry, ONTARIO, L9L 1B2
TEL:(905)982-0520 FAX:(905)982-0609

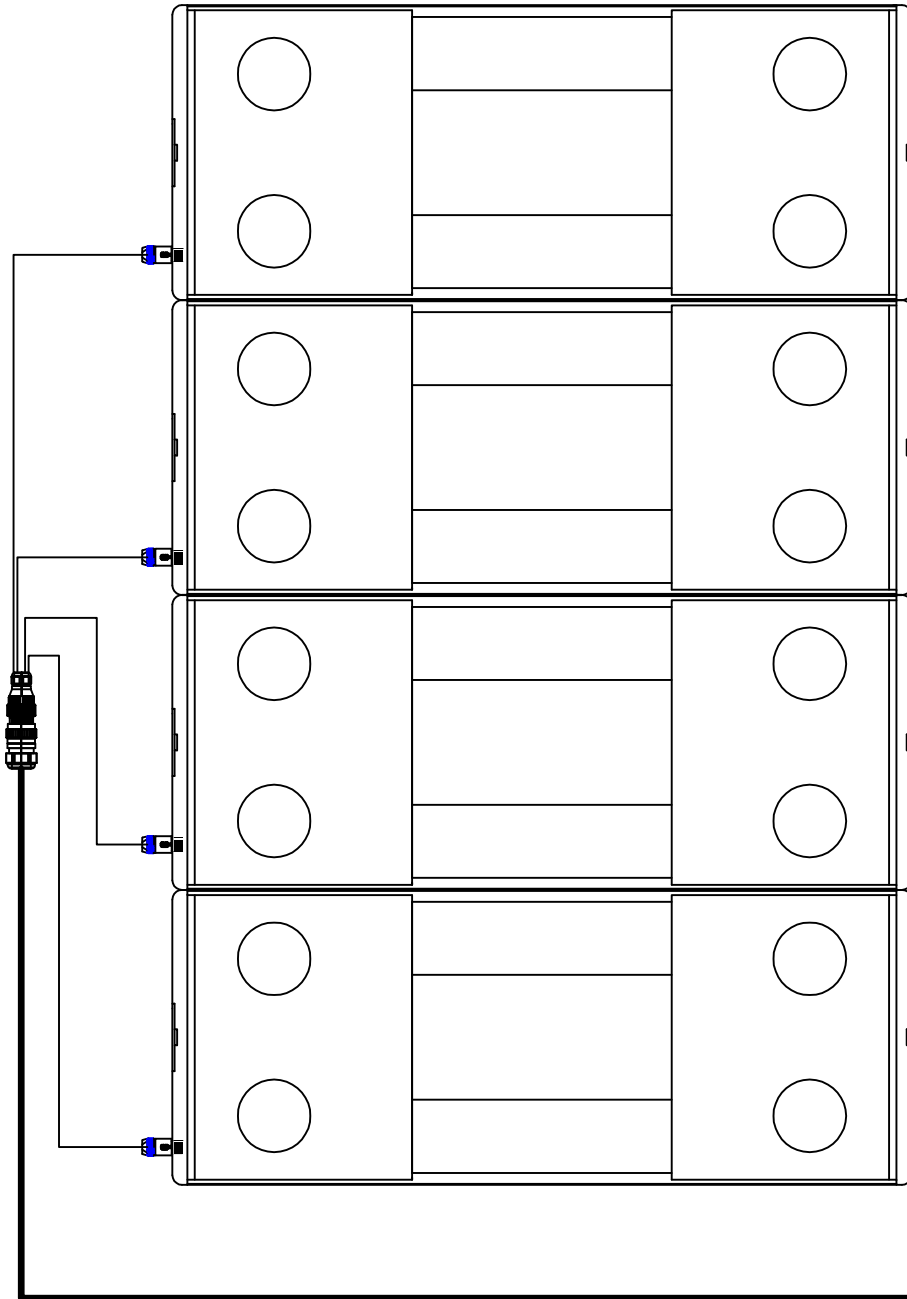

XTA DP424	Out 4	Note: The XTA Processor is typically located in a Y18/Y10 amplifier rack.
(magenta) fp 6400	Sub	
Amp 1	CH A / CH B	
Gain=29dB MLS 0dB		
(magenta) fp 6400		
Amp 2	CH A / CH B	
Gain=29dB MLS 0dB		
(magenta) fp 6400		
Amp 3	CH A / CH B	
Gain=29dB MLS 0dB		
(magenta) fp 6400		
Amp 4	CH A / CH B	
Gain=29dB MLS 0dB		

CHANGE	
DATE: 2008-12-15	DRN: J.S.
SCALE: NTS	APPV'D:
DISK:	FILE:
PROJECT: System Configurations (fp)	
DRAWING: 4 T21 (Soca)	
Plot: 2/2 (Amp Rack)	Issue: 1

